

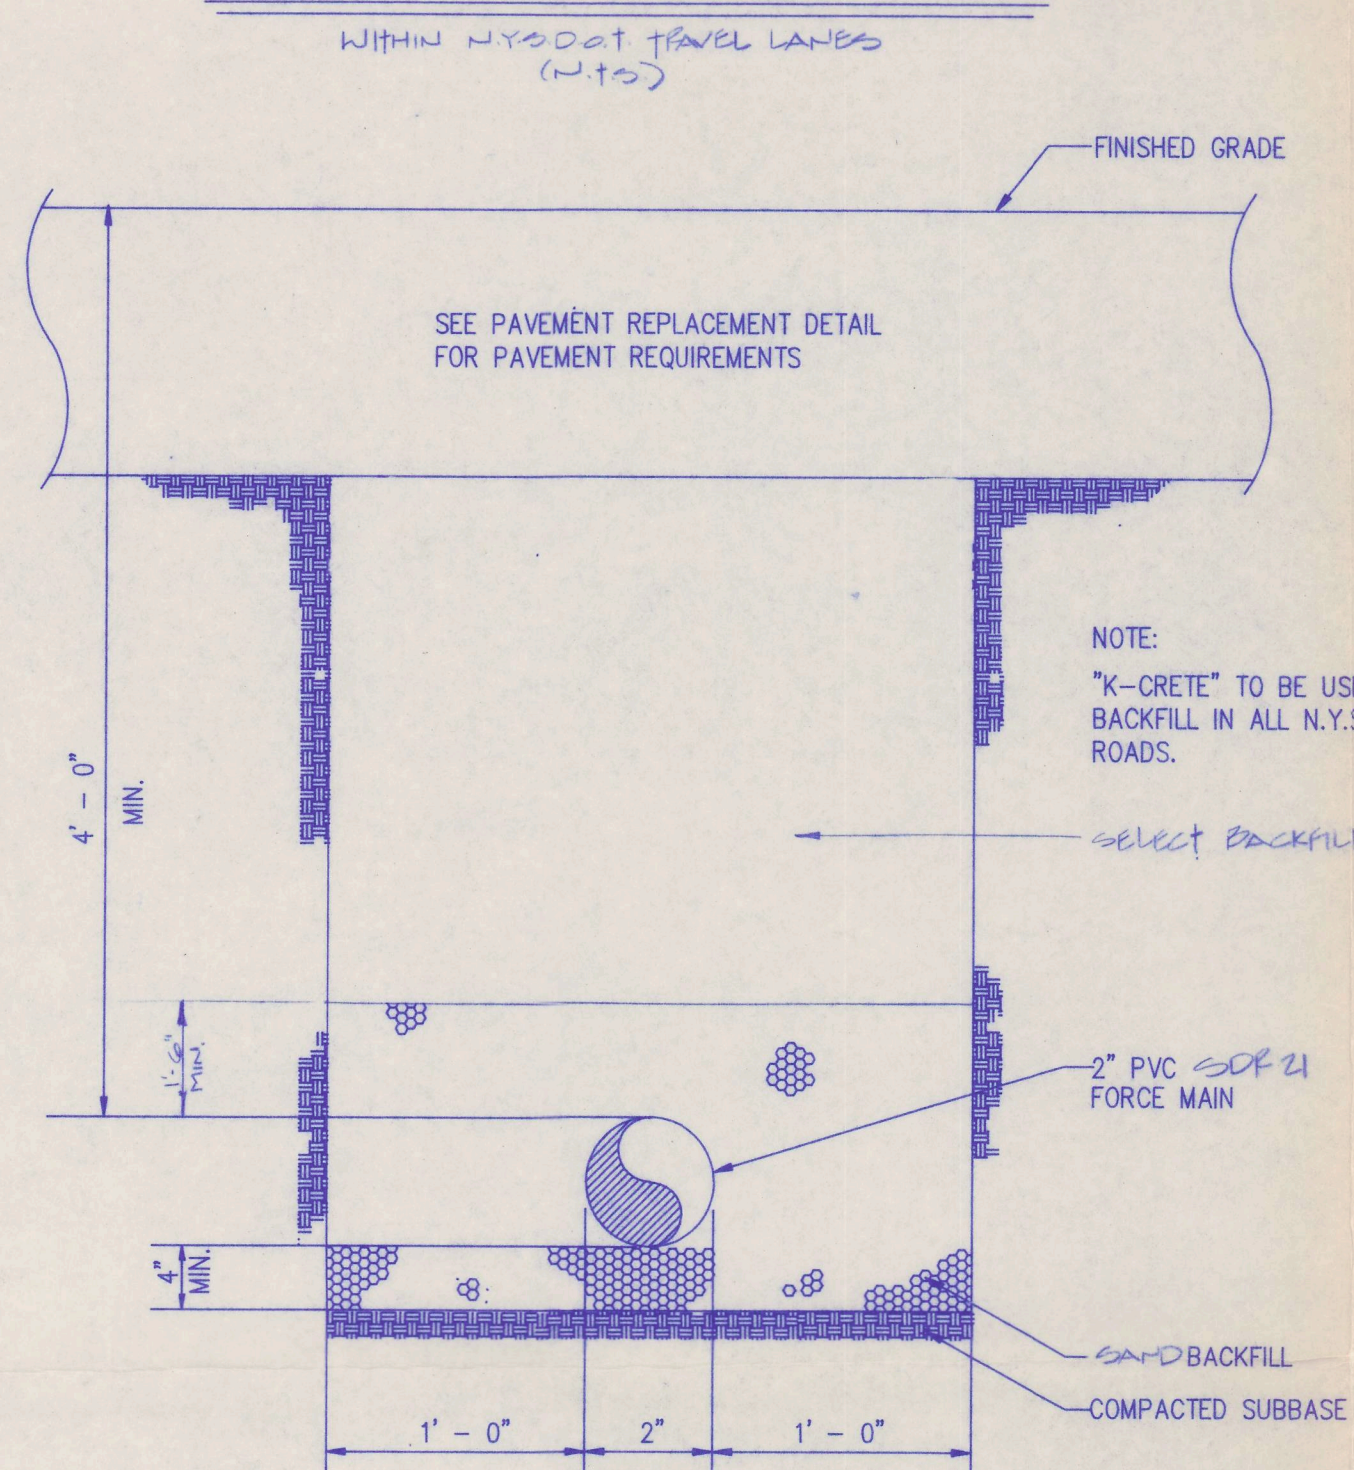
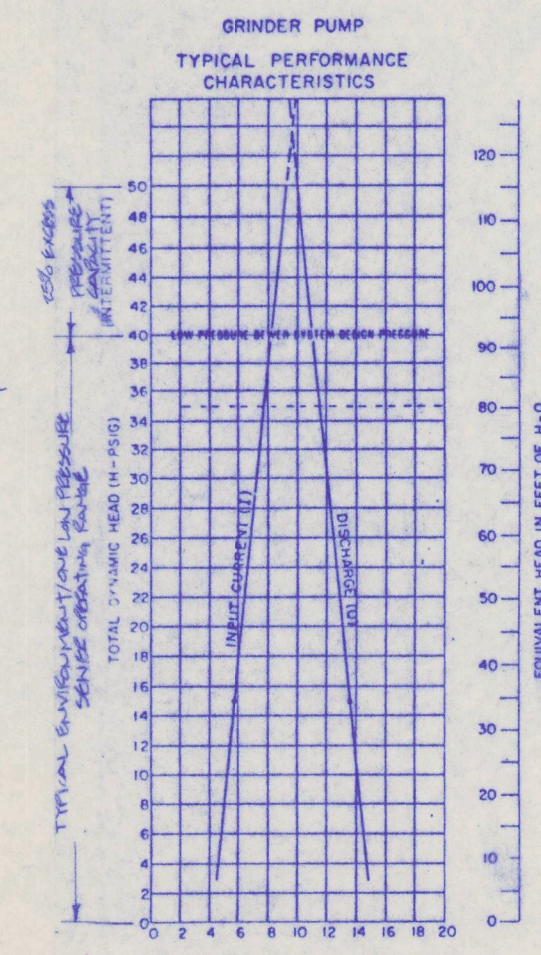



PAVEMENT REPLACEMENT DETAIL

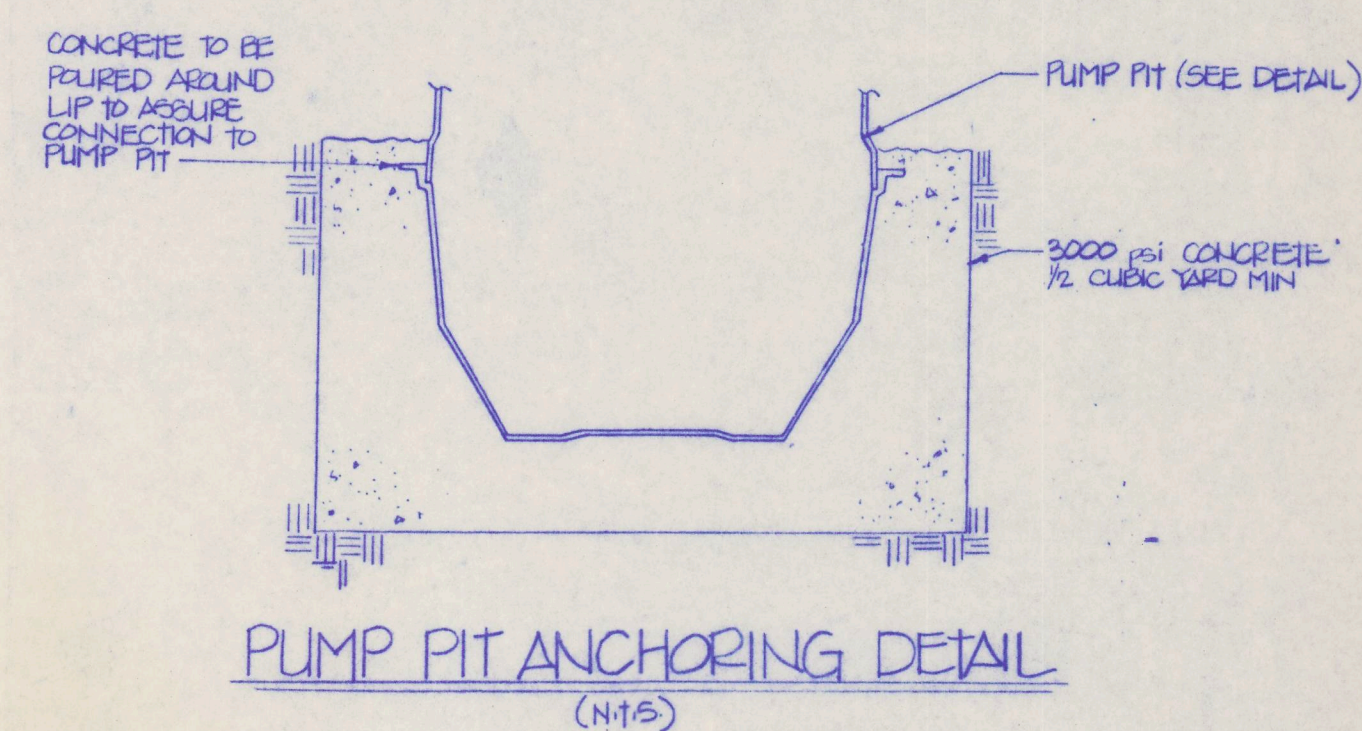


FORCE MAIN TRENCH DETAIL (N.T.S.)

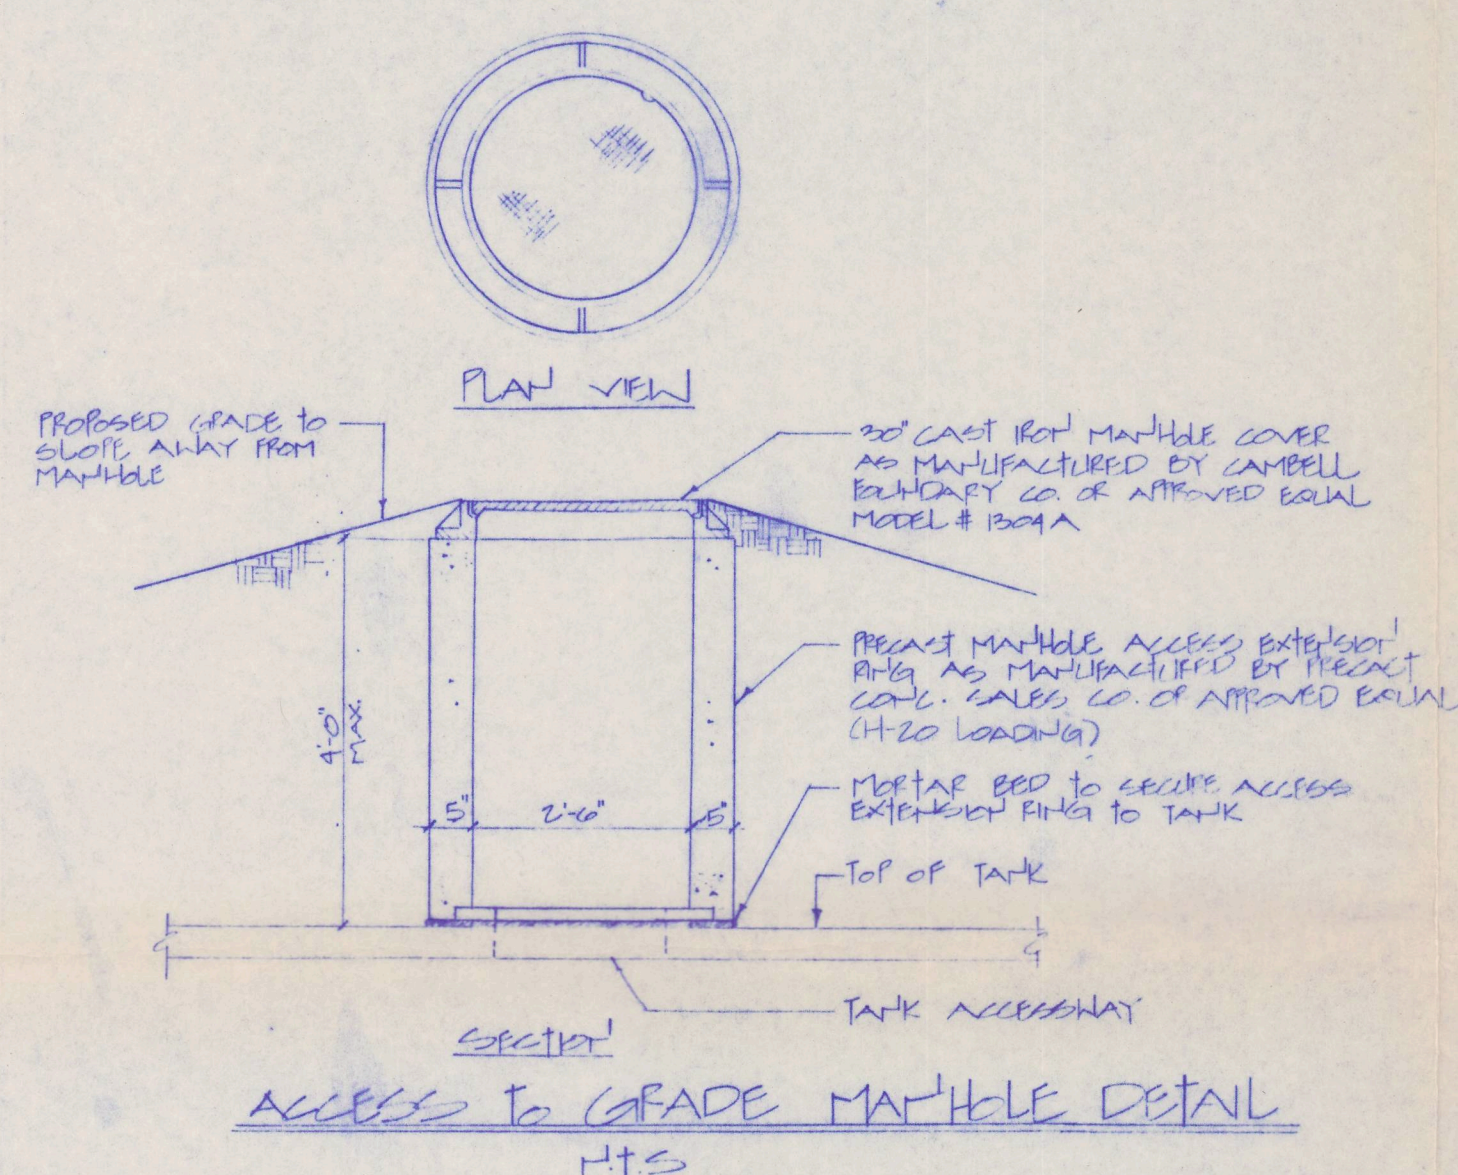


PUMP CURVE

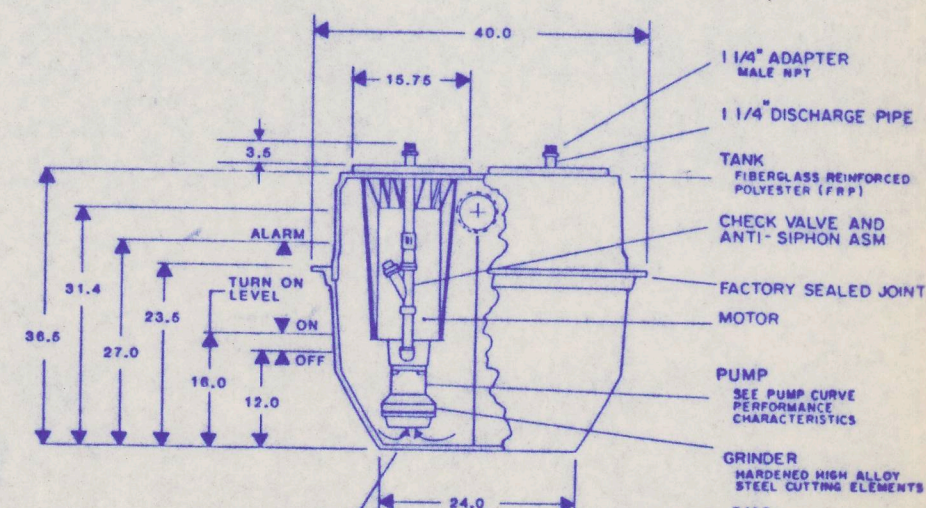




CONTROL LEVELS

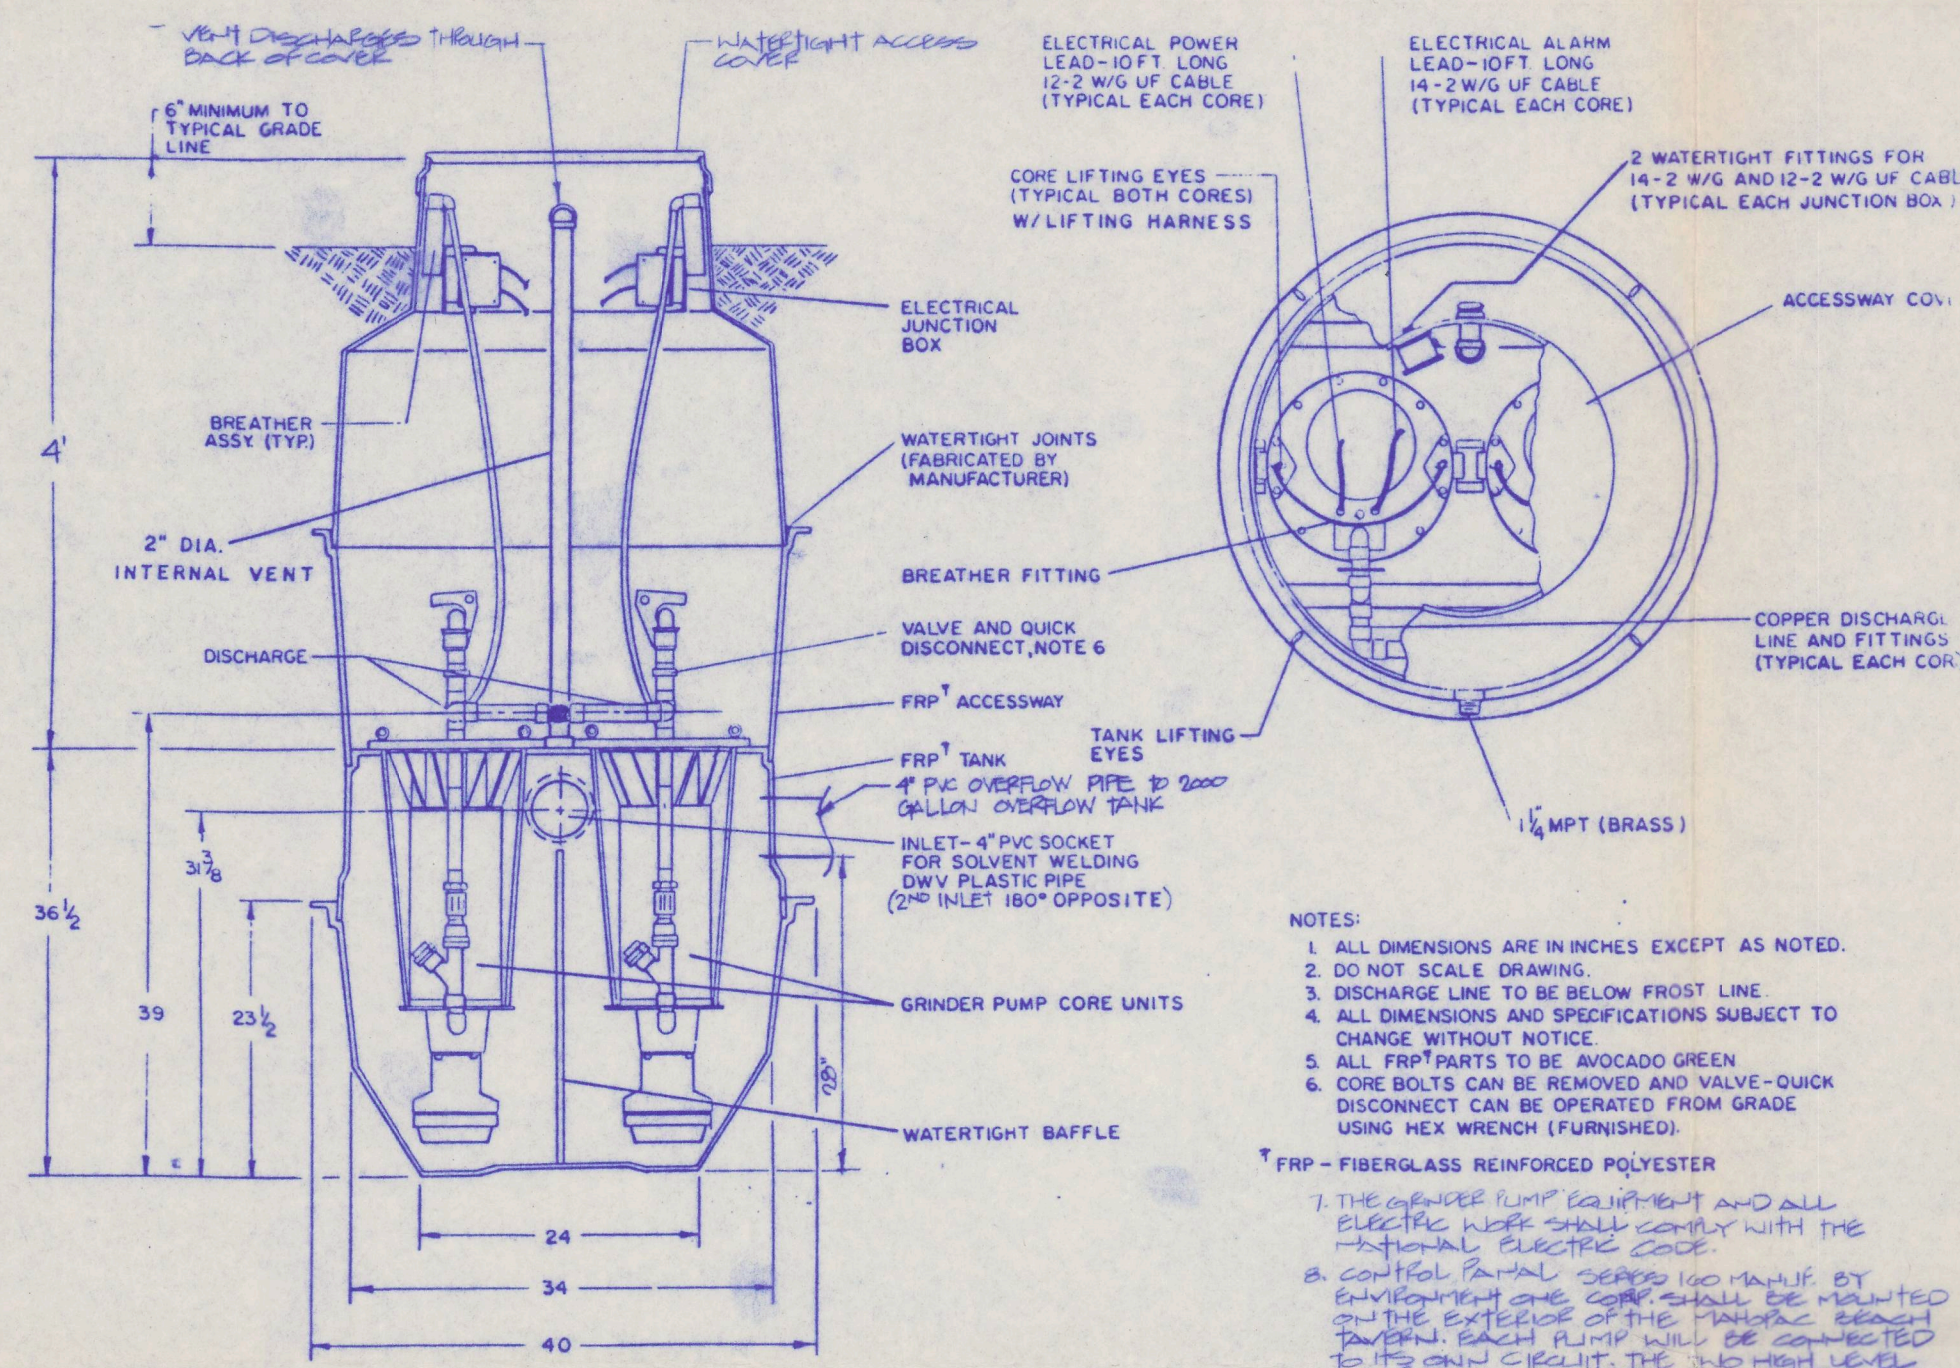



PUMP PIT DETAIL (N.T.S.)

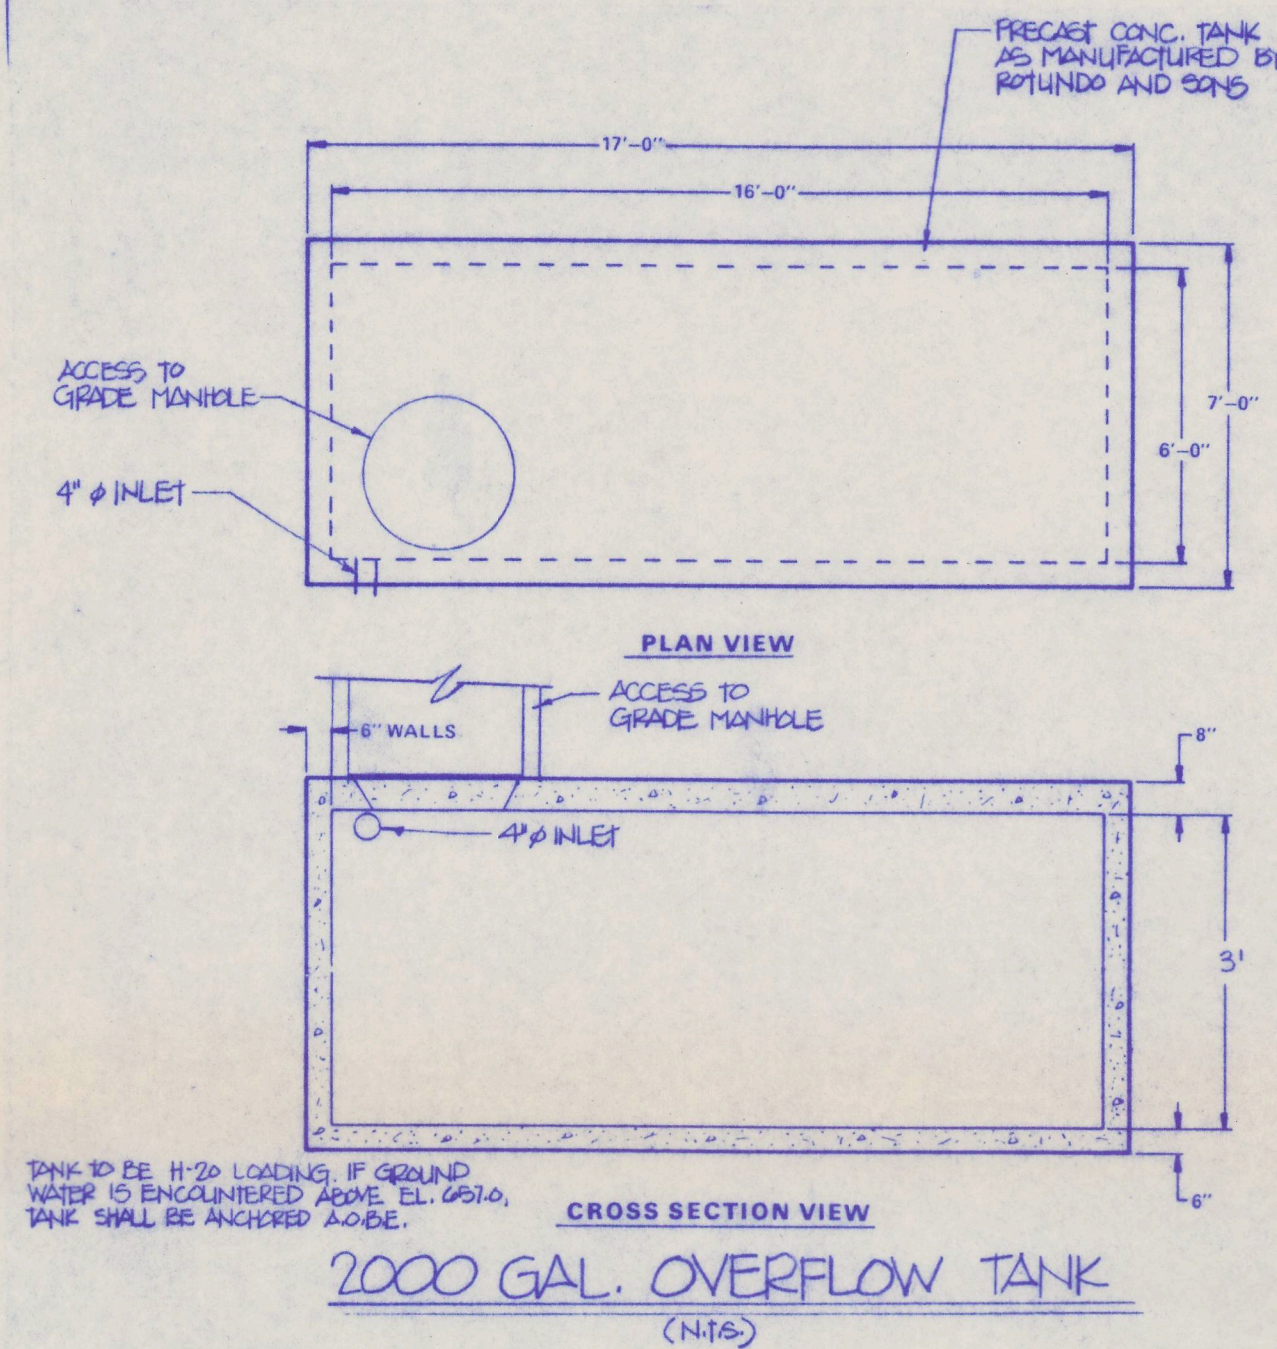

2000 GAL. OVERFLOW TANK (N.T.S.)

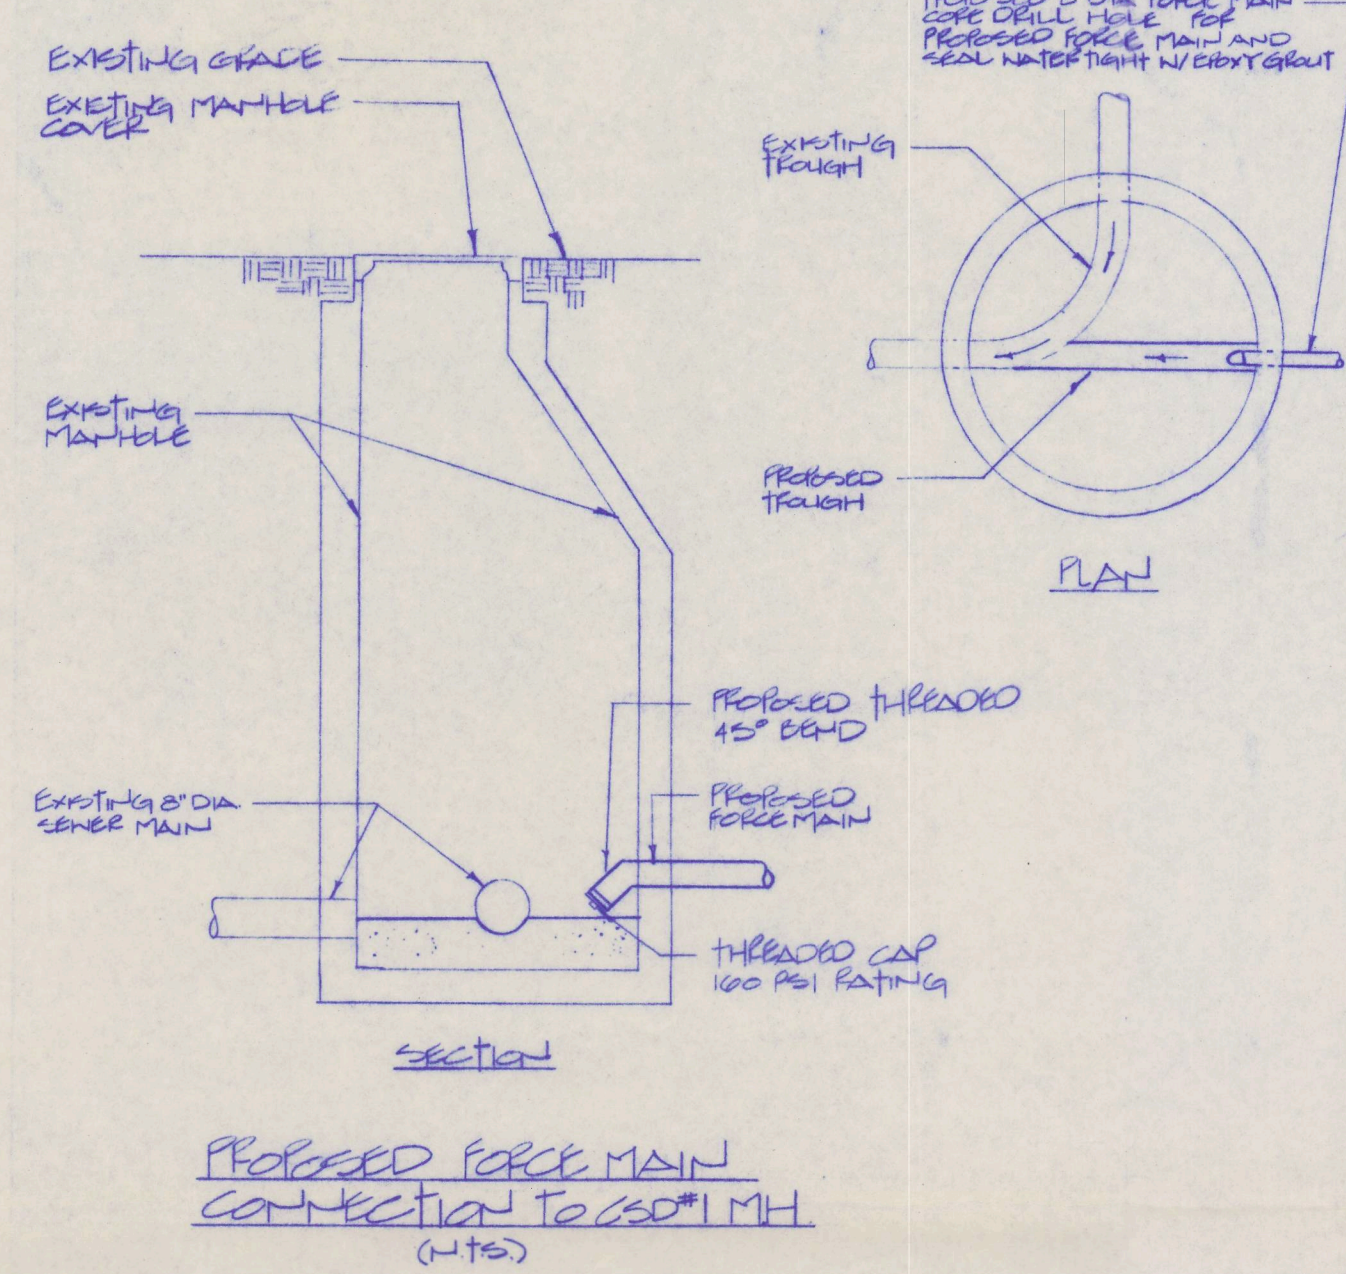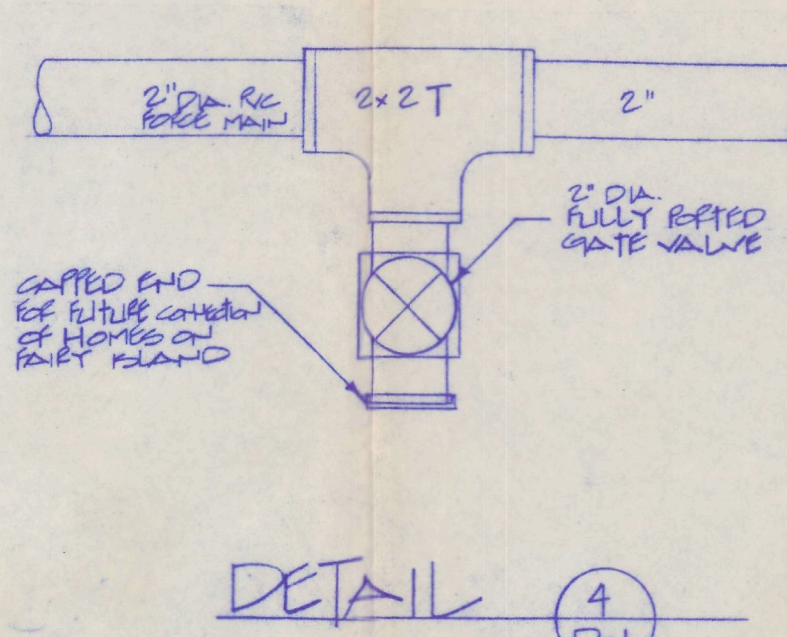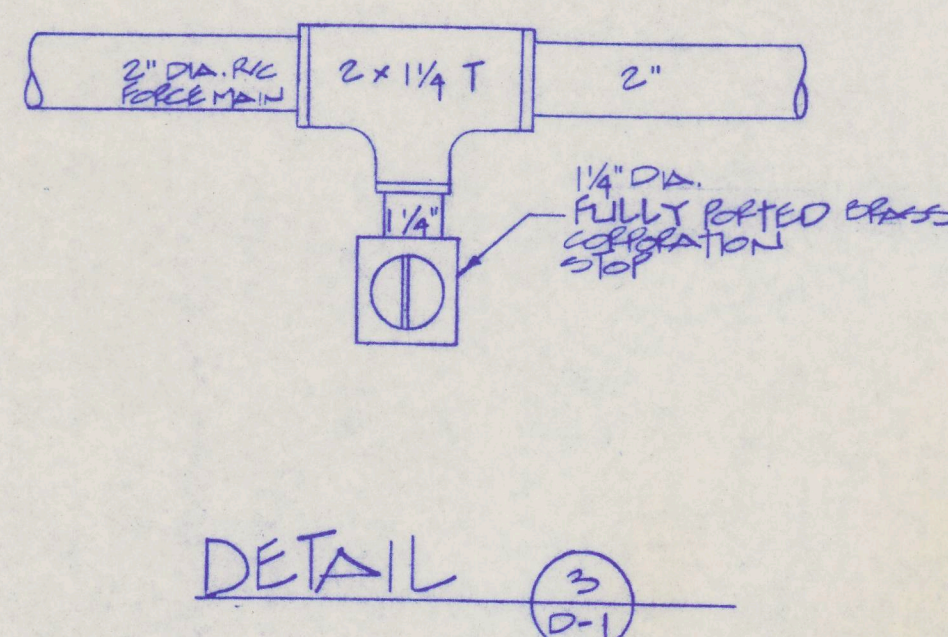


PROPOSED FORCE MAIN CONNECTION TO 360\"/>

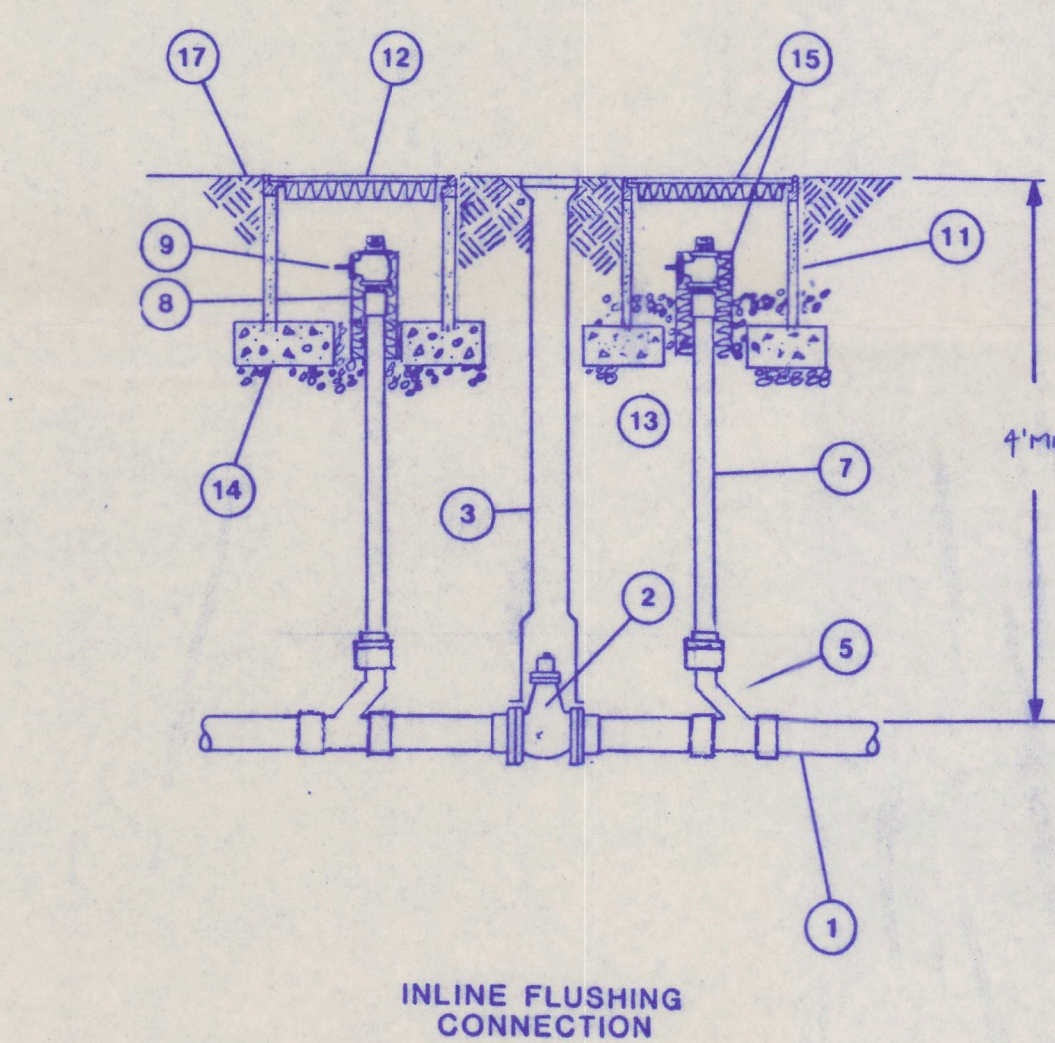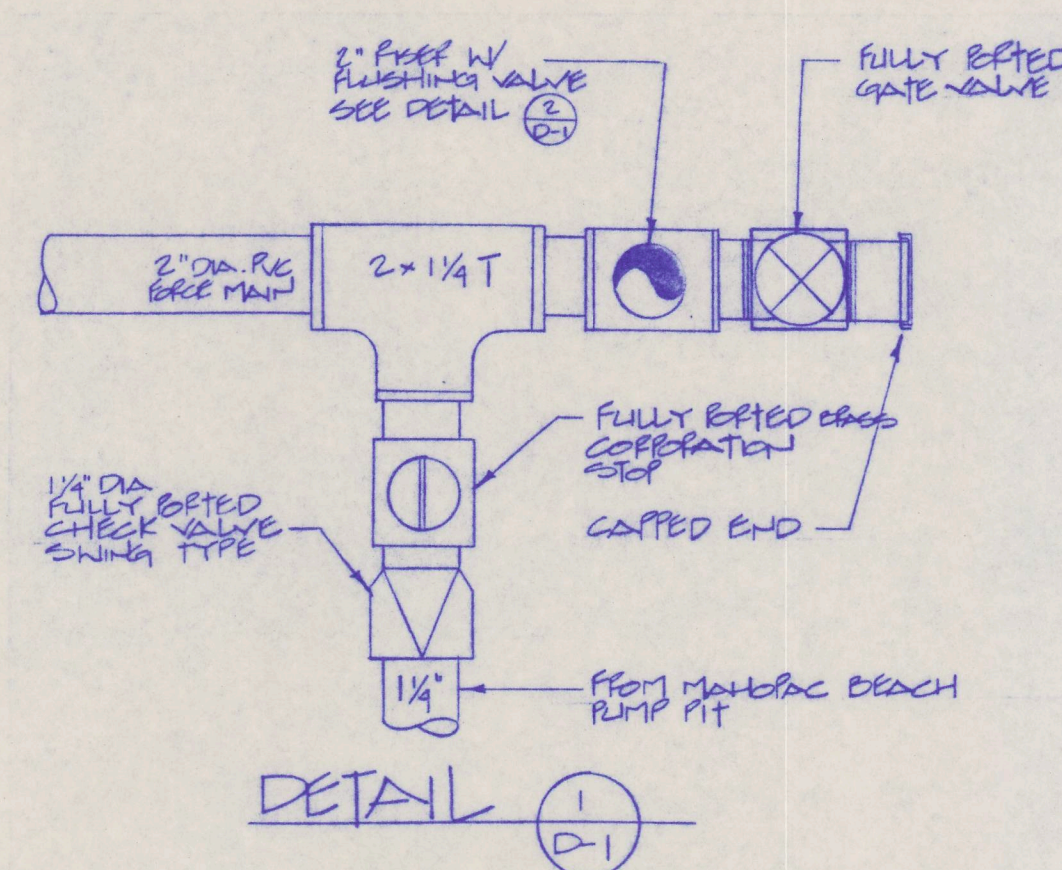

FLUSHING CONNECTIONS

1. LOW PRESSURE SEWER SYSTEM (LPSS) MAIN
  2. GATE VALVE - fully ported, size of LPSS main.
  3. VALVE BOX - length as required.
  4. WYE - size of LPSS main.
  5. 3\"/>
11. PRECAST CONCRETE VALVE BOX - 1420
  12. COVER - 1\"/>
  - 13. GRAVEL BEDDING
  - 14. CONCRETE PAD
  - 15. INSULATION
  - 17. FINISHED GRADE

DETAIL 2 (D-1)

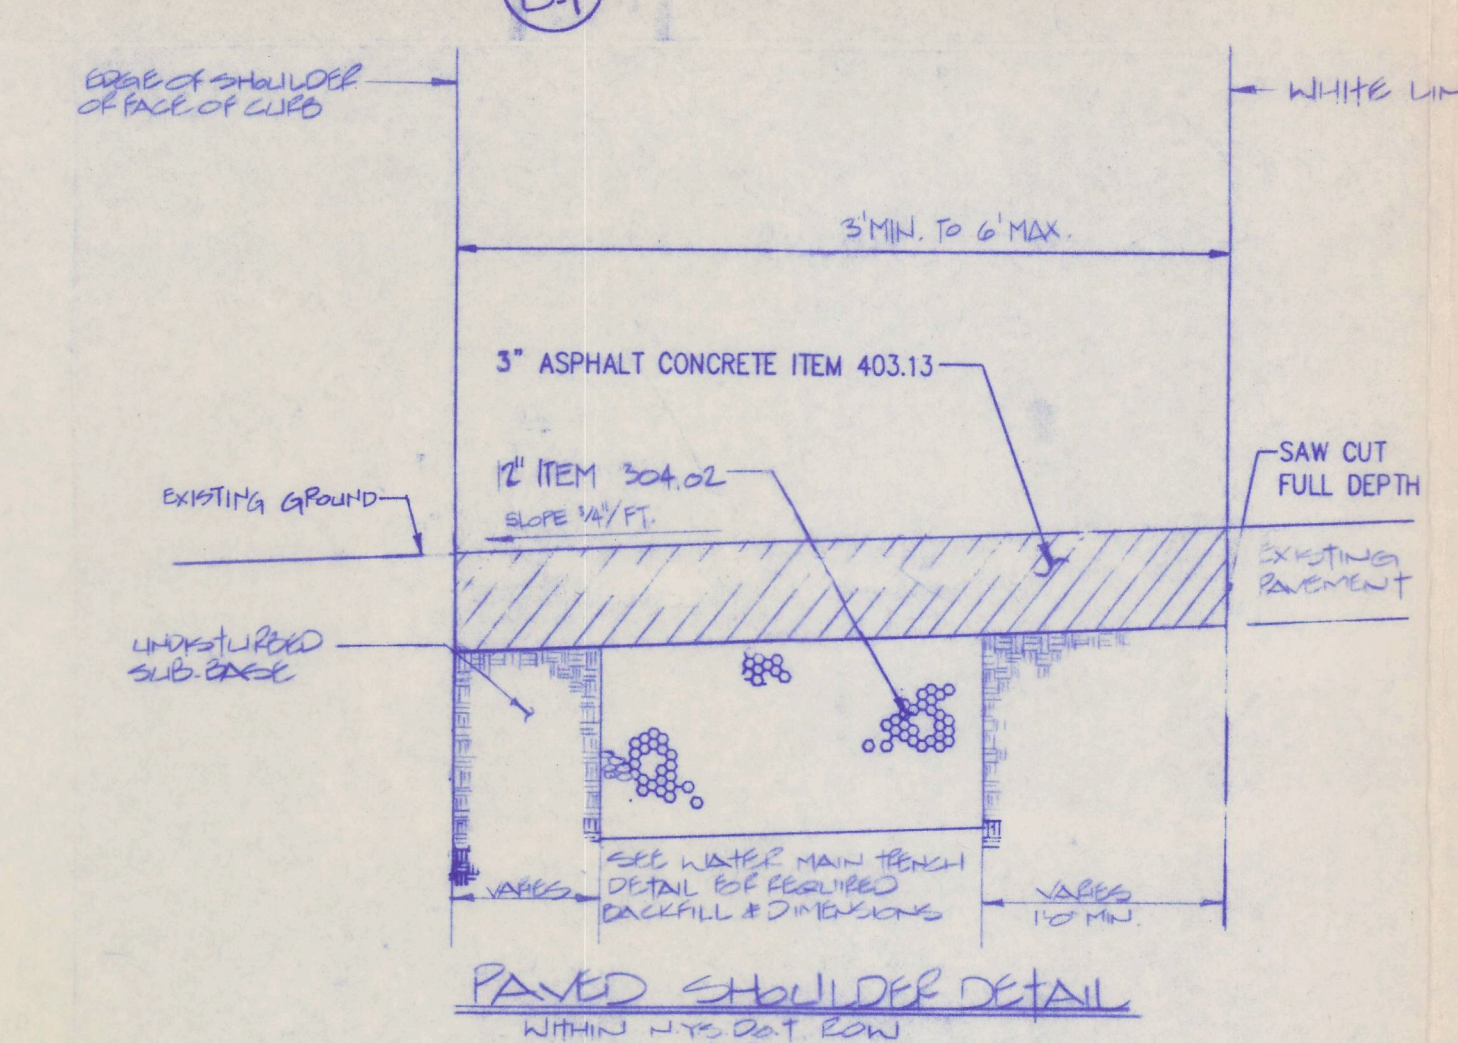

PAVED SHOULDER DETAIL (N.T.S.)

PUTNAM COUNTY HEALTH DEPARTMENT NOTES

1. Putnam County Health Department certification is based on the location of the pump pit, overflow tank, well, building setbacks, road and driveways as shown on the approved drawing. Modifications are to have prior Putnam County Health Department approval.
2. Unauthorized modifications made to this drawing after the date of Putnam County Health Department approval voids said approval.
3. Putnam County Health Department approval is based on use by a maximum of 100 patrons. Any increase in the number of patrons will require prior approval from this Department.
4. A water meter shall be installed and daily readings furnished to the Putnam County Health Department each month.
5. The pump pit is to receive sanitary wastes only. The discharge of industrial wastes, contaminated cooling water, or other deleterious substances into or onto the surface of the ground is prohibited. The Putnam County Health Department reserves the right of inspection of the premises to insure compliance with these requirements.
6. Putnam County Health Department shall be promptly notified in the event that any wastes other than strictly domestic sanitary wastes are produced at this facility.
7. The conditions noted on the Putnam County Department of Health letter of Approval are an integral part of this approval and compliance is required.
8. The existing SSDS is to be permanently abandoned any tankage is to be cleaned, crushed, and filled with suitable fill.

6	1/27/93	REV PER RHD COMMENTS	JMK
5	1/7/93	REV PER RHD COMMENTS	JMK
4	12/7/92	REV PER MEMO (10/4/92) & SHD MEMO (10/1/92)	JMK
3	7/29/92	REV PER NYS DOT COMMENTS	JMK
2	7/21/92	REV PER NYS DOT COMMENTS	JMK
1	6/1/92	REV PER NYS DOT COMMENTS	JMK
NO.	DATE	REVISION	BY
<b>INSITE ENGINEERING &amp; DESIGN, P.C.</b> 76 BREWSTER AVE., CARMEL, NEW YORK 10512 (914) 225-6200			
PROJECT: THE MAHOPAC BEACH			
DRAWING: DETAILS			
PROJECT NO.	92106	PROJECT MANAGER	JJC
DATE	3-4-92	DRAWN BY	MPB
SCALE	AS NOTED	CHECKED BY	WJS
DRAWING NO.	D-1	SHEET	2

PUTNAM COUNTY DEPARTMENT OF HEALTH  
DIVISION OF ENVIRONMENTAL HEALTH SERVICES  
Carmel, New York 10512

These plans are hereby approved pursuant to Article 17 of the Putnam County Sanitary Code and Article 17 of the New York State Environmental Conservation Law, subject to the provisions of the Letter of Approval issued this date. See first sheet for signature.

